


# the synergist

## Supplement to “A Nomogram for Lab Hoods” [UPDATED]

Use the nomogram below to determine approximate values for parameters related to lab hoods when two or more parameters are known and hood air is at standard temperature and pressure. For a full explanation and correction factors for non-STP conditions, see the article “A Nomogram for Lab Hoods” in the March 2019 issue.

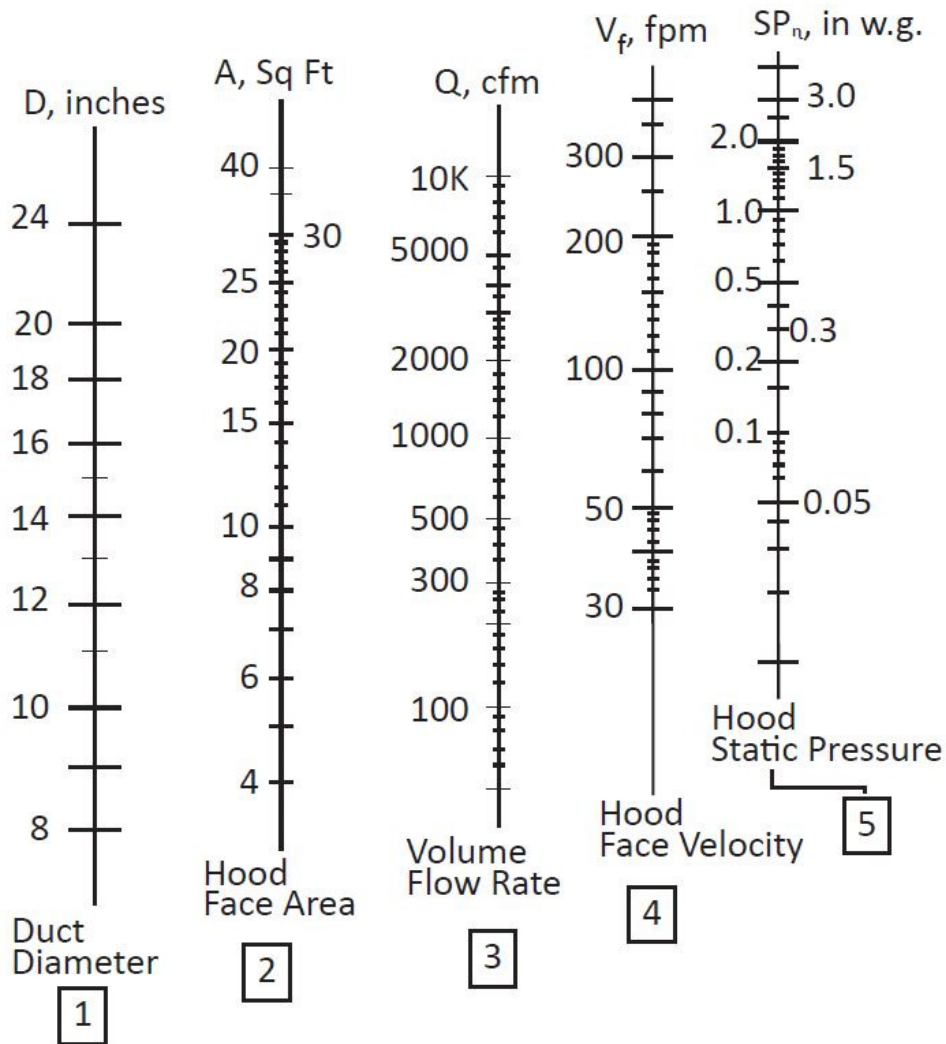

Nomogram developed by D. Jeff Burton and originally published by *Occupational Health and Safety Magazine*.